
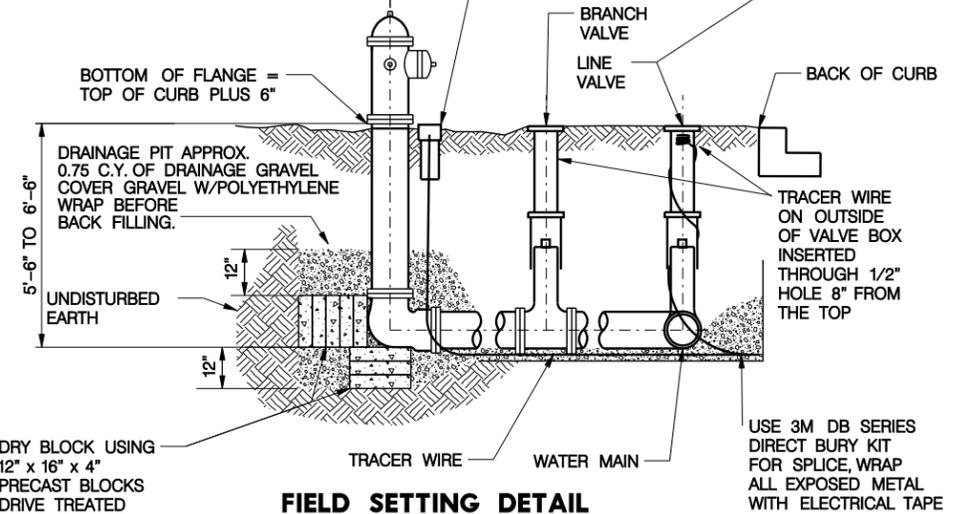
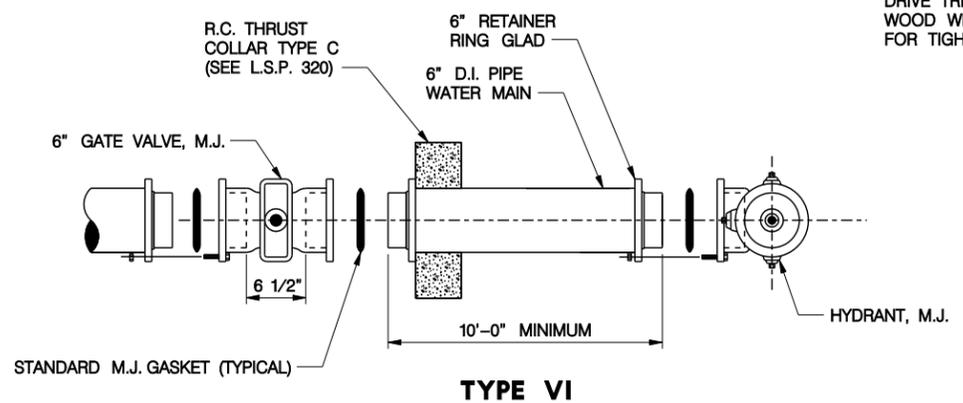
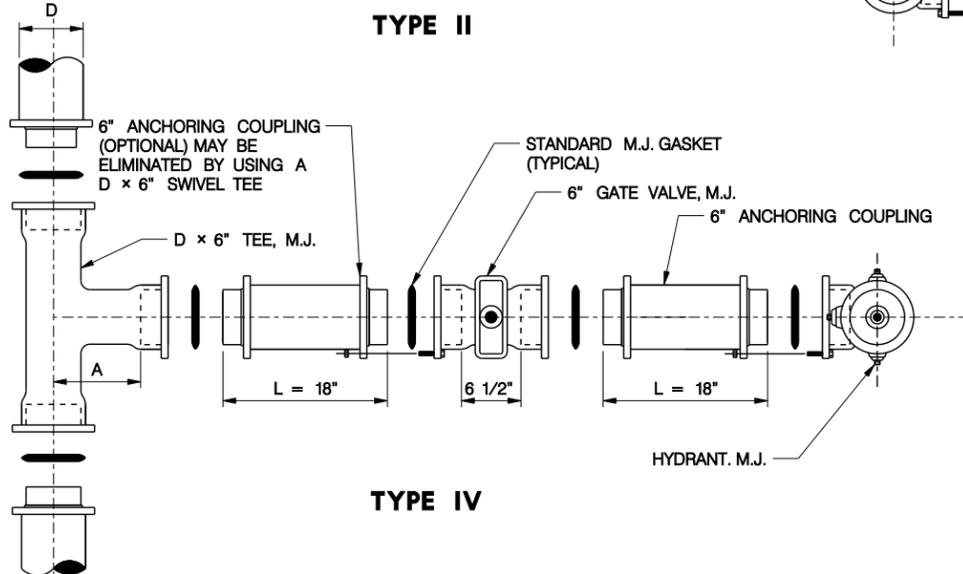
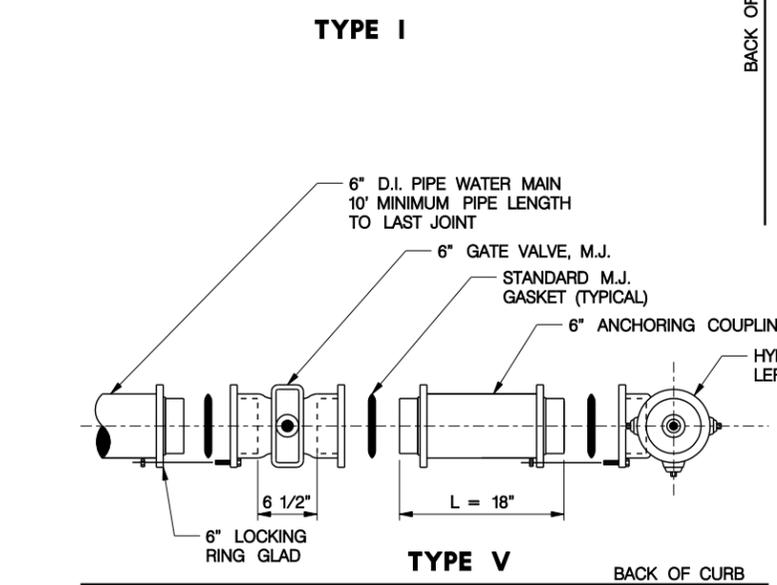
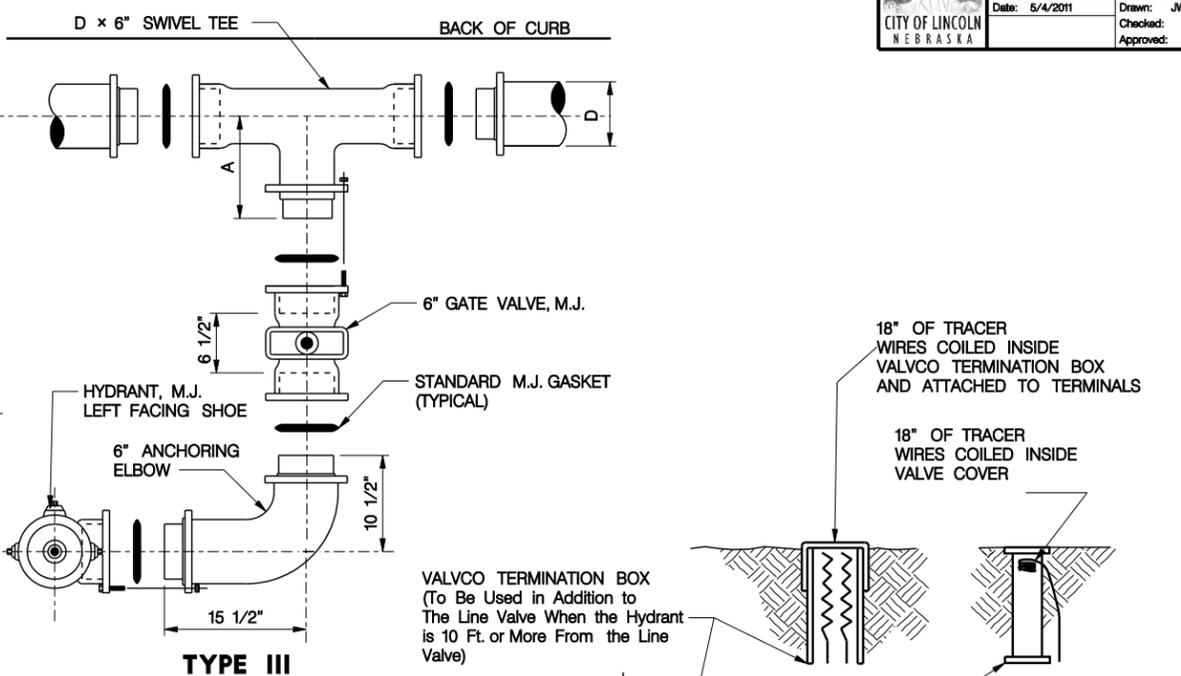
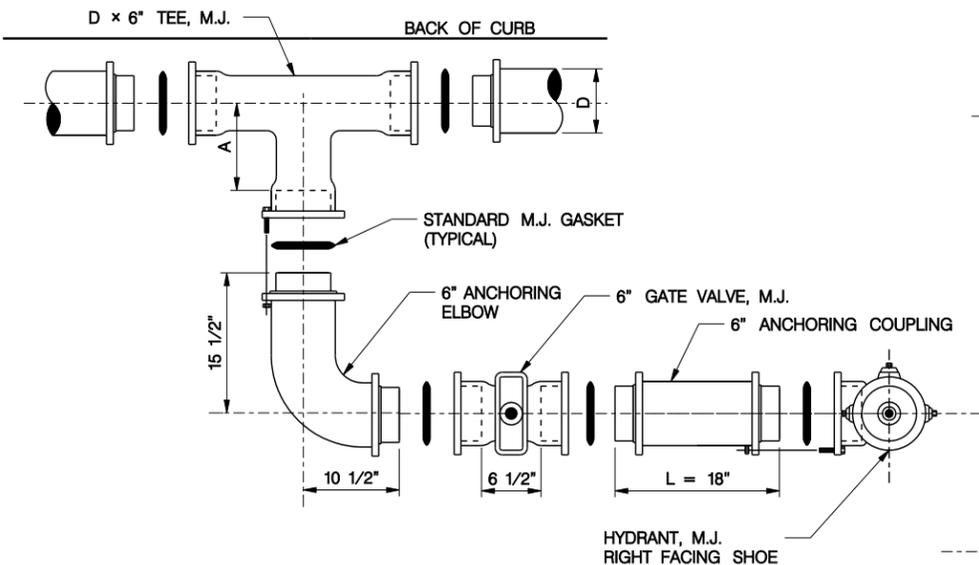


PROJ: 70028 OLD AS OF 070610.dwg  
 PEN: \\ables\Pen\SW\_PENTABLE.TBL  
 USER: elocaw  
 DATE: 9/27/2011  
 DGN: ..STANDARD\_Current\Nep330et.dgn

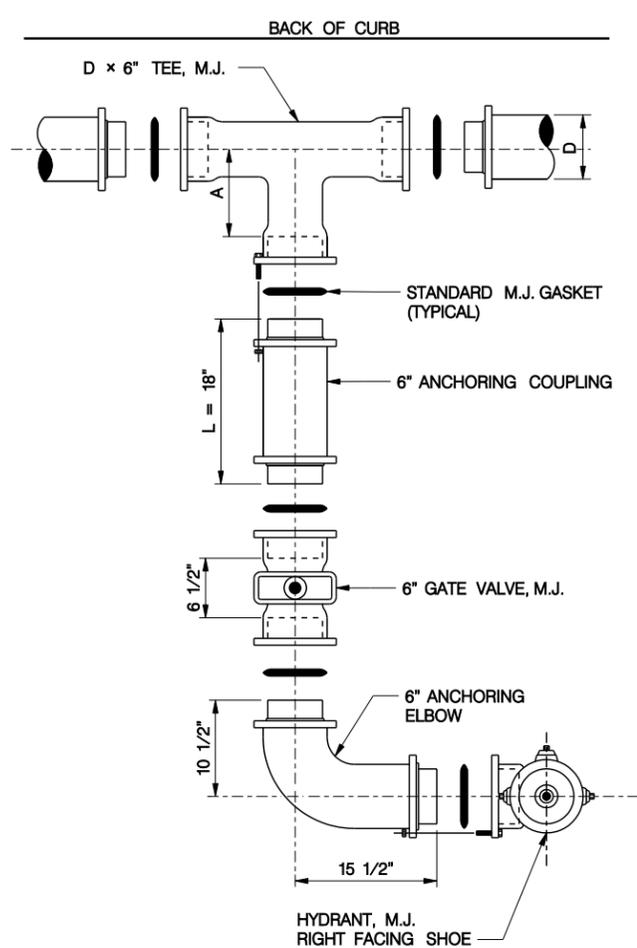

**NOTES:**

ALL ANCHORING COUPLINGS SHALL BE 18" IN LENGTH UNLESS PLANS SHOW OTHERWISE

ALL ANCHORING COUPLINGS AND ANCHORING ELBOWS SHALL BE CAST WITH AN INTEGRAL M.J. GLAND ON ONE END AND A DUCTILE IRON ROTATABLE M.J. GLAND ON THE OTHER END.

A LOCKING RING FOR A STANDARD ANCHORING COUPLING SHALL BE SUBSTITUTED FOR ONE OF THE STANDARD GLANDS ON THE 6" GATE VALVE FOR THE TYPE V AND TYPE VI INSTALLATIONS.

BACKFILL OF HYDRANTS AND VALVES SHALL BE COMPACTED BY HAND WITH SUITABLE MECHANICAL EQUIPMENT.

THERE SHALL BE NO MORE THAN ONE HYDRANT EXTENSION.

HYDRANT SHALL DRAIN FREELY AFTER INSTALLATION, DRAIN MATERIAL SHALL BE DRAINAGE GRAVEL ONLY, NO LIMESTONE MATERIAL

THE HYDRANT SHOE SHALL BE DRY BLOCKED, NO POUR IN PLACE BLOCKING

WHEN HYDRANT IS MORE THAN TEN (10) FEET FROM WATER MAIN, TRACER WIRE SHALL BE EXTENDED AND TERMINATED IN VALVCO TERMINATION BOX (OR EQUAL) LOCATED ON THE STREET SIDE OF THE HYDRANT.

HYDRANT BRANCH VALVES SHALL BE OPENED PRIOR TO PRESSURE TESTING WATER MAIN.



TEE CONNECTION DIMENSIONS			
MAIN RUN SIZE D	SIZE BRANCH	BRANCH LENGTH SWIVEL TEE A	BRANCH LENGTH A
6"	6"	10.5"	8"
8"	6"	11.5"	9"
12"	6"	14.5"	12"
16"	6"	17.5"	15"
24"	6"	21.5"	19"
30"	6"	24.5"	23"

HYDRANT ASSEMBLY	NUMBER OF FITTINGS REQUIRED						
	5 1/4" PUMPER HYDRANT	6" GATE VALVE, M.J.	6" ANCHORING COUPLING, M.J.	ELBOW, M.J. 6" ANCHORING	D X 6" TEE, M.J.	D X 6" SWIVEL TEE, M.J.	R.C. THRUST COLLAR (TYPE C)
TYPE I	1	1	1	1	1		
TYPE II	1	1	1	1	1		
TYPE III	1	1		1		1	
TYPE IV	1	1	2		1		
TYPE V	1	1	1				
TYPE VI	1	1					1


PROJ: 70028\_OLD AS OF 070610.dwg  
 PEN: ..\\ables\\Pen\\SW\_PENTABLE.TBL  
 USER: elocaw  
 DATE: 9/27/2011  
 DGN: ..\\STANDARD\\Current\\lsp330e2.dgn

PROJECT NO. SHEET NO.	
LSP 330	2
Date: 6/4/2011	Drawn: JWH/CEA
	Checked: Approved:

# CORRECT HYDRANT ORIENTATION

TYPES I, II, III


NOTE:  
 THE CONTRACTOR SHALL ORIENT THE LARGE STEAMER  
 NOZZLE OF THE HYDRANT TO FACE THE ROADWAY

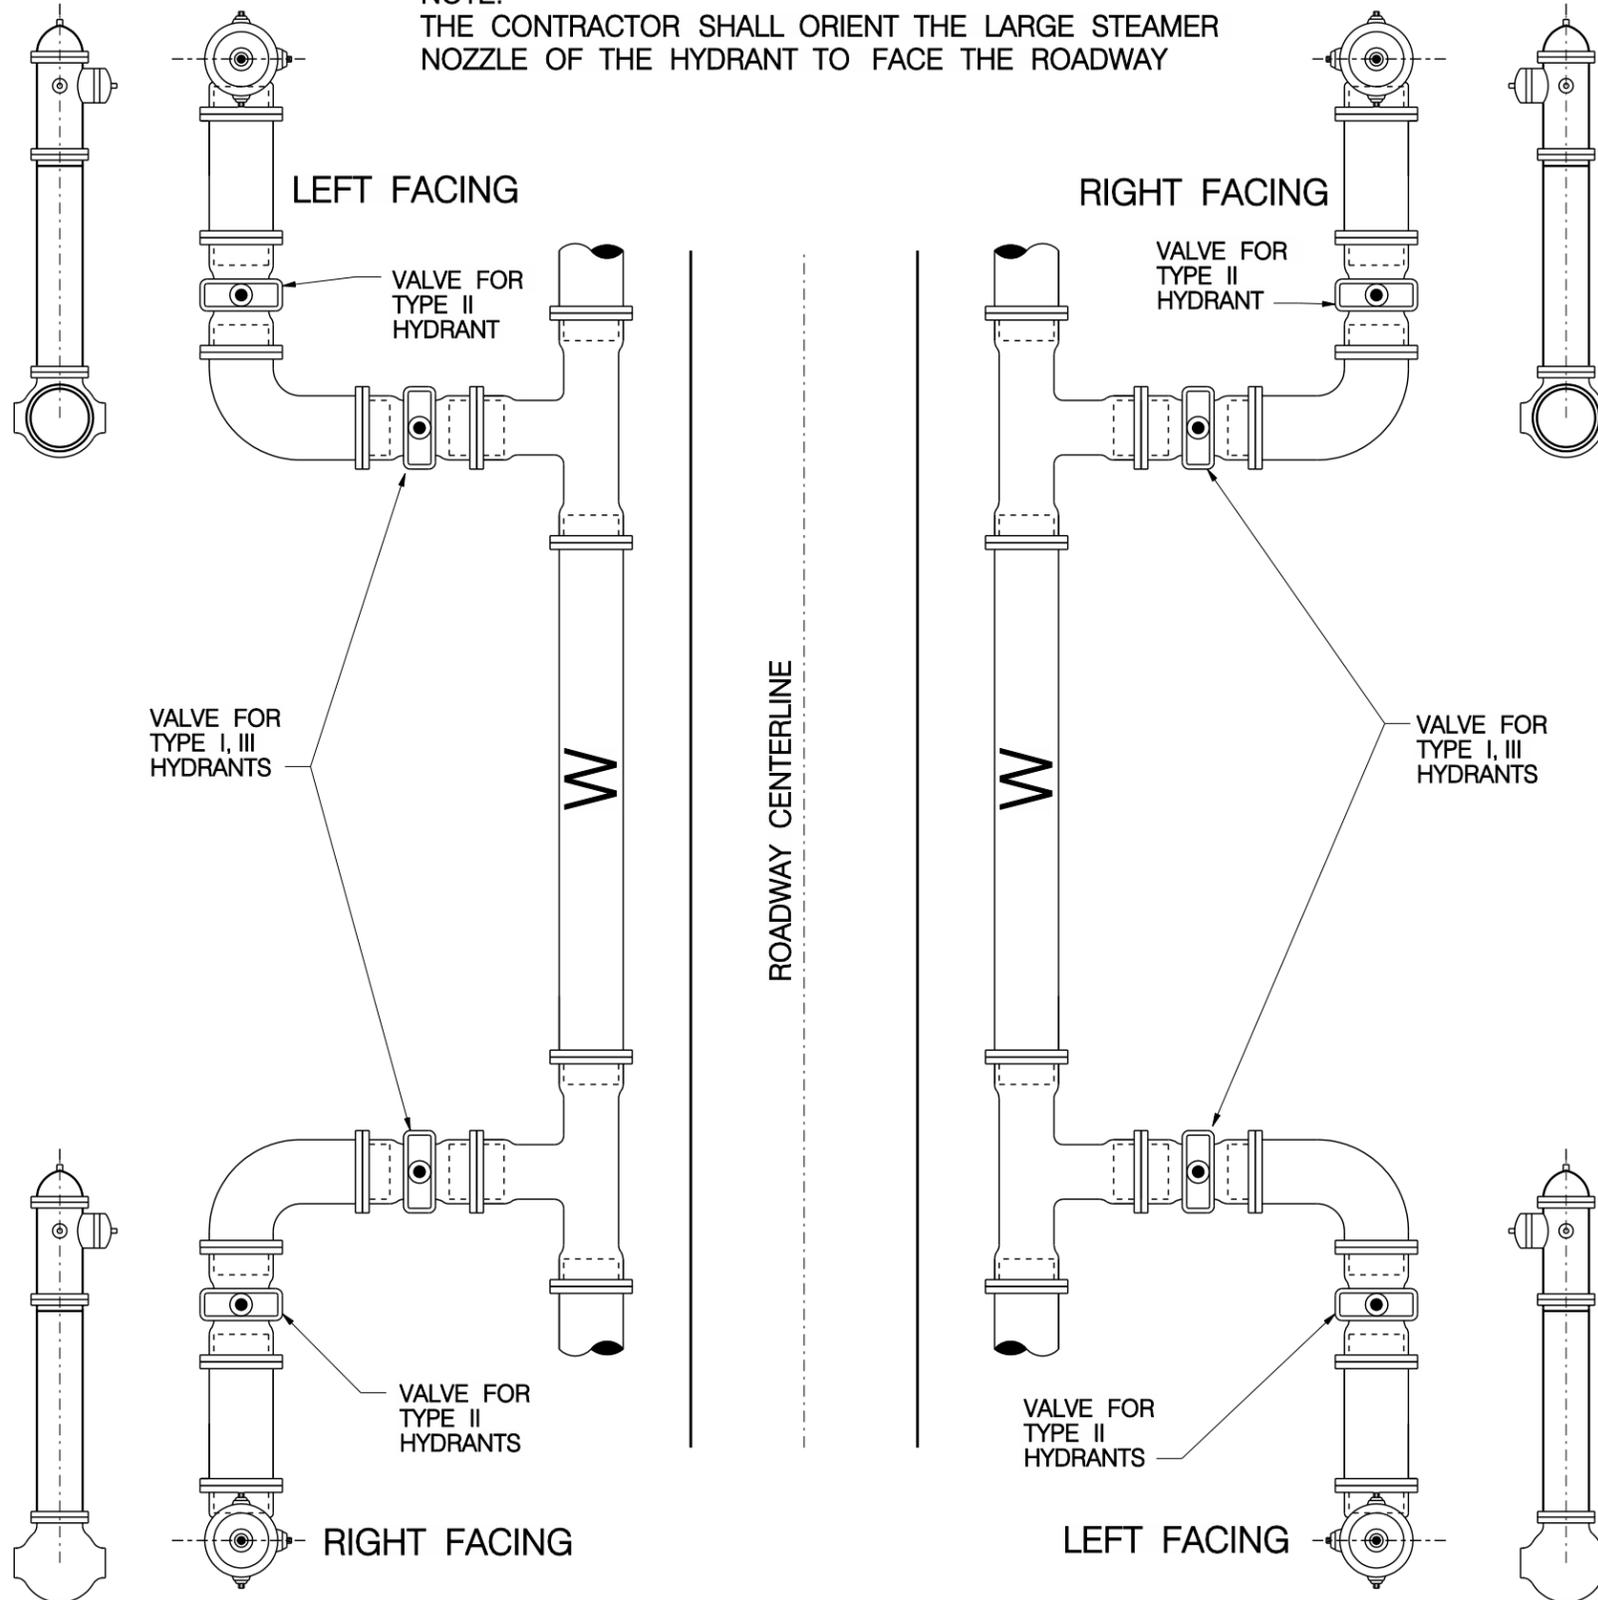

# HYDRANT CONFIGURATION

RIGHT FACING SHOE

LEFT FACING SHOE

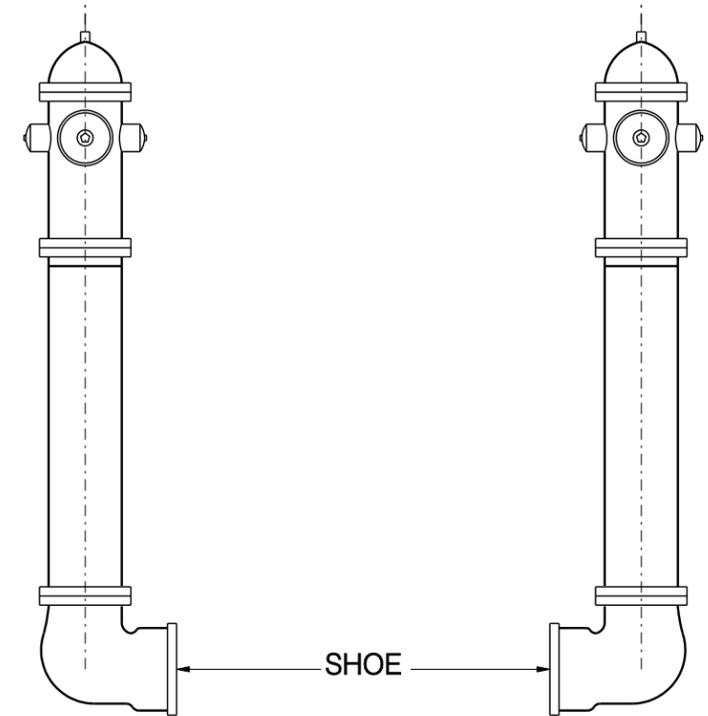

WHEN FACING THE  
 LARGE STEAMER  
 NOZZLE, THE HYDRANT  
 SHOE POINTS RIGHT

WHEN FACING THE  
 LARGE STEAMER  
 NOZZLE, THE HYDRANT  
 SHOE POINTS LEFT



EFFECTIVE JULY 1, 2011 - HYDRANT INSTALLATIONS  
 L.S.P. 330

LSP 330

This document was originally issued and sealed by Steve R. Owen, E-6812, on 6-6-11. This media should not be considered a certified document.